


#### NOTES:

1. Class 560-C-3250 Concrete to be used.
2. Pipe size and inlet and outlet flow line elevations to be shown on improvement plans.
3. When pipe sizes greater than 18" are used a larger frame and cover may be required by the City Engineer
4. V is a maximum of 4' For depths greater than 4' or for a vehicular traffic situation use Std. Dwg. 430 or 431.
5. Bike proof grating shall be used instead of solid cover when shown on plans.

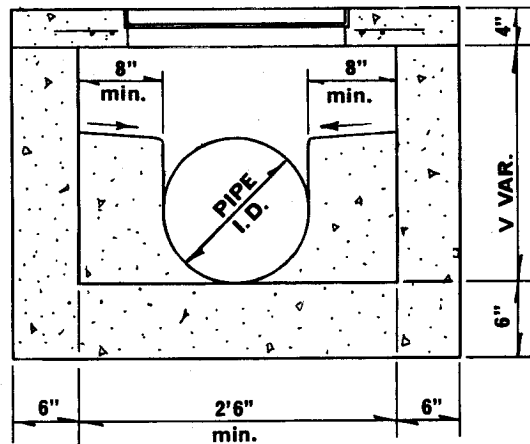

APPROVED	<i>[Signature]</i>	DATE	3-8-74
CITY	PUBLIC WORKS DIRECTOR - R.C.E. 8134		
1	Changed 6" clearance to 3"	4/23/84	
2	REMOVED LOCKING REQ.	4/29/84	

CITY OF RIVERSIDE  
PUBLIC WORKS DEPT. - ENGINEERING DIV.

CLEANOUT BOX

STANDARD DRAWING NO.

425